

## 检测报告

编号 : GZIN2108046692MR\_CN

日期 : 2021-08-27

页码 : 1 of 6



客户名称: 深圳华捷新材料有限公司  
客户地址: 深圳市坪山区坪山街道和平社区兰金四路 19 号华瀚科技工业园厂房 2 栋 107

样品名称 : HJ-GS3015 强渗透型有机硅混凝土重防水新材料

以上信息及样品由客户提供及确认, SGS 不承担证实客户提供信息的准确性、适当性和(或)完整性的责任。

\*\*\*\*\*

SGS 参考号 : CP21-043360  
收样日期 : 2021-08-12  
测试开始时间 : 2021-08-12  
测试结束时间 : 2021-08-27  
测试结果 : 请见下页 (除另有特别说明外, 此报告结果仅对测试样品负责)

通标标准技术服务有限公司广州分公司  
检测中心  
授权签名

霍洁梅

授权签字人



## 检测报告

编号 : GZIN2108046692MR\_CN

日期 : 2021-08-27


页码 : 2 of 6

结果总结:

序号	测试项目	测试方法	结果	结论
1	温度循环测试	客户提供	详见结果	合格

备注: 合格: 达到要求  
 不合格: 未达到要求  
 /: 不下判定

原样照片:

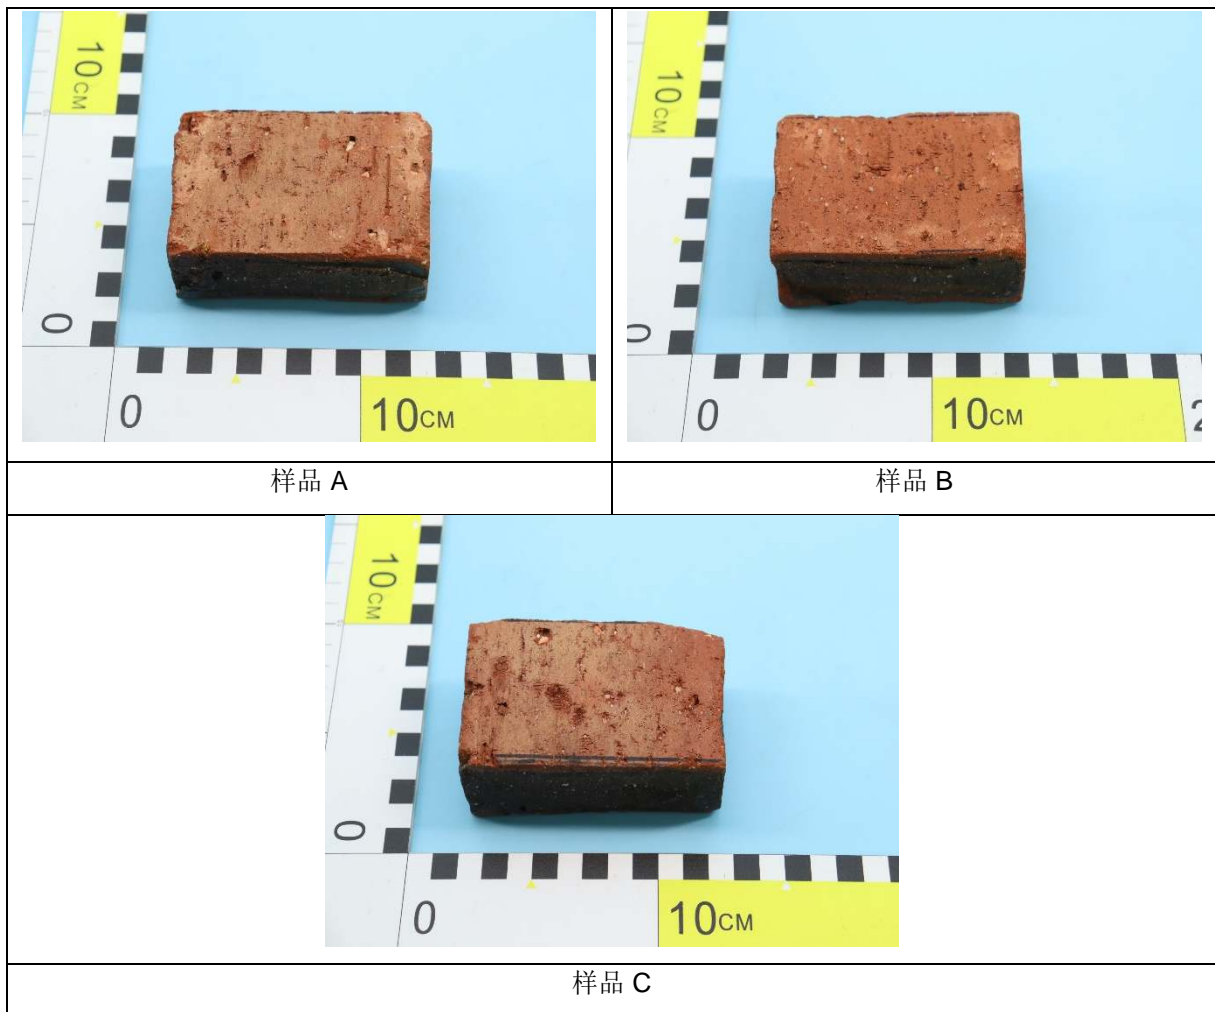

## 检测报告

编号 : GZIN2108046692MR\_CN

日期 : 2021-08-27

页码 : 3 of 6

测试项目: 温度循环测试

样品描述: 混凝土块

测试方法: 客户提供

测试条件:

步骤	初始条件	终止条件	时间
1	25℃	-40℃	2 h
2	-40℃	-40℃	8 h
3	-40℃	150℃	4 h
4	150℃	150℃	8 h
5	150℃	-40℃	4 h
6	-40℃	25℃	2 h

步骤 2~5 为 1 个循环, 步骤 2~5 做 4 循环后, 最后做步骤 6, 共 100 小时

测试后, 劈开混凝土淋水。

实验室环境条件: 15℃ ~ 35℃, 25%RH ~ 75%RH

测试结果:

样品	测试结果	客户要求	结论
A	1. 无可见开裂、褪色; 2. 劈开后淋水, 每个面的防水层厚度 > 2mm.	1. 无可见开裂、褪色; 2. 劈开后淋水, 每个面的防水层厚度 ≥ 2mm.	合格
B	1. 无可见开裂、褪色; 2. 劈开后淋水, 每个面的防水层厚度 > 2mm.		合格
C	1. 无可见开裂、褪色; 2. 劈开后淋水, 每个面的防水层厚度 > 2mm.		合格



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only. Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

SGS-CSTC Inspection & Testing Services Co., Ltd. 198 Kazhu Road, Sciotech Park Guangzhou Economic & Technology Development District, Guangzhou, China 510663 t (86-20) 82155555 f (86-20) 82075188 www.sgs.com.cn  
 中国·广州·经济技术开发区科学城科珠路198号 邮编: 510663 t (86-20) 82155555 f (86-20) 82075188 e sgs.china@sgs.com


## 检测报告

编号 : GZIN2108046692MR\_CN

日期 : 2021-08-27

页码 : 4 of 6

测试照片:

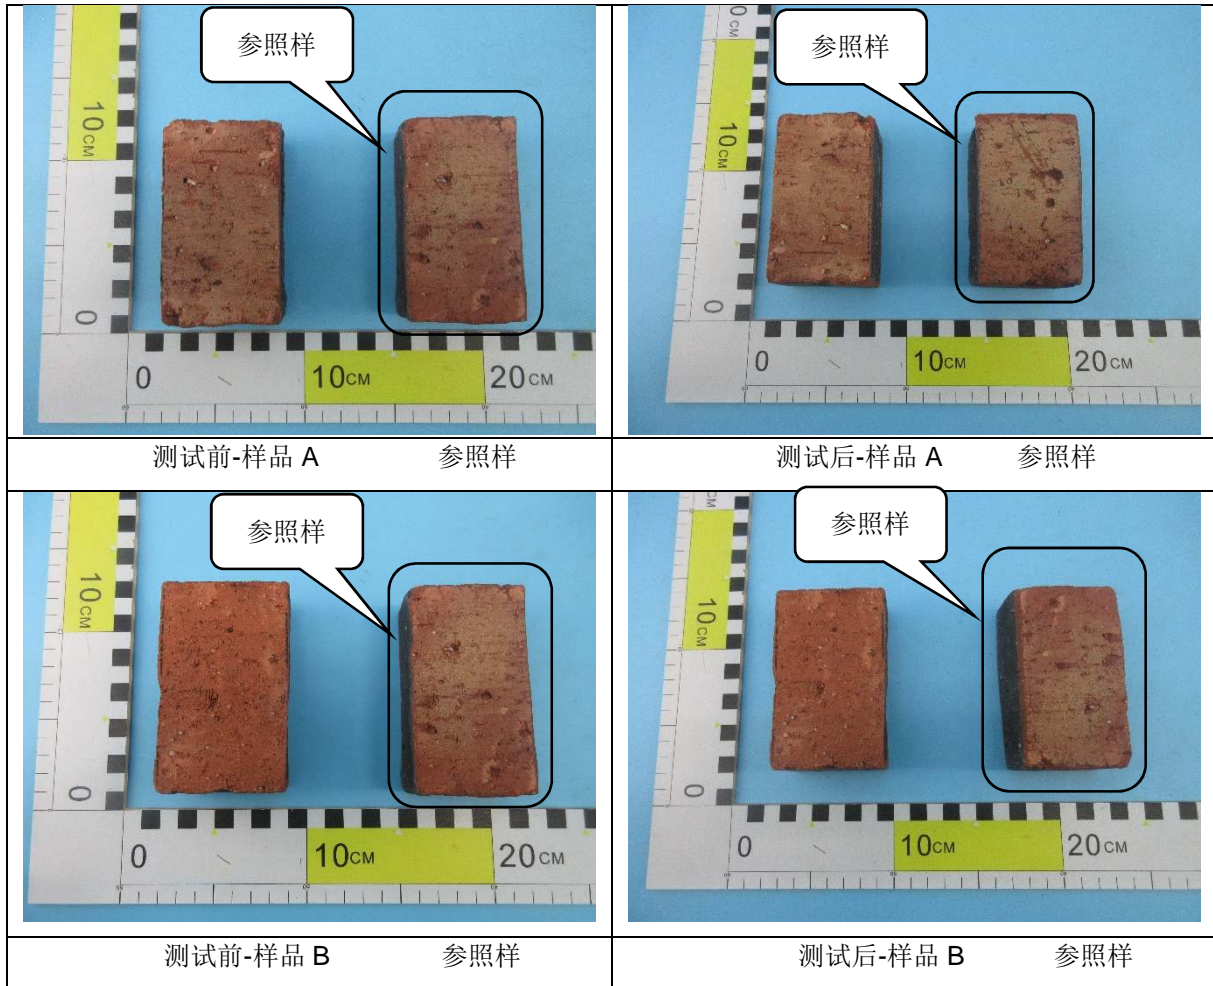

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only. Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

SGS-CSTC 标准技术服务有限公司  
Guangzhou Branch Testing Center/Reliability Laboratory


198 Kazhu Road, Sciencetech Park Guangzhou Economic & Technology Development District, Guangzhou, China 510663 t(86-20) 82155555 f(86-20) 82075188 www.sgs.com.cn  
中国·广州·经济技术开发区科学城科珠路198号 邮编:510663 t(86-20) 82155555 f(86-20) 82075188 e sgs.china@sgs.com

## 检测报告

编号 : GZIN2108046692MR\_CN

日期 : 2021-08-27

页码 : 5 of 6

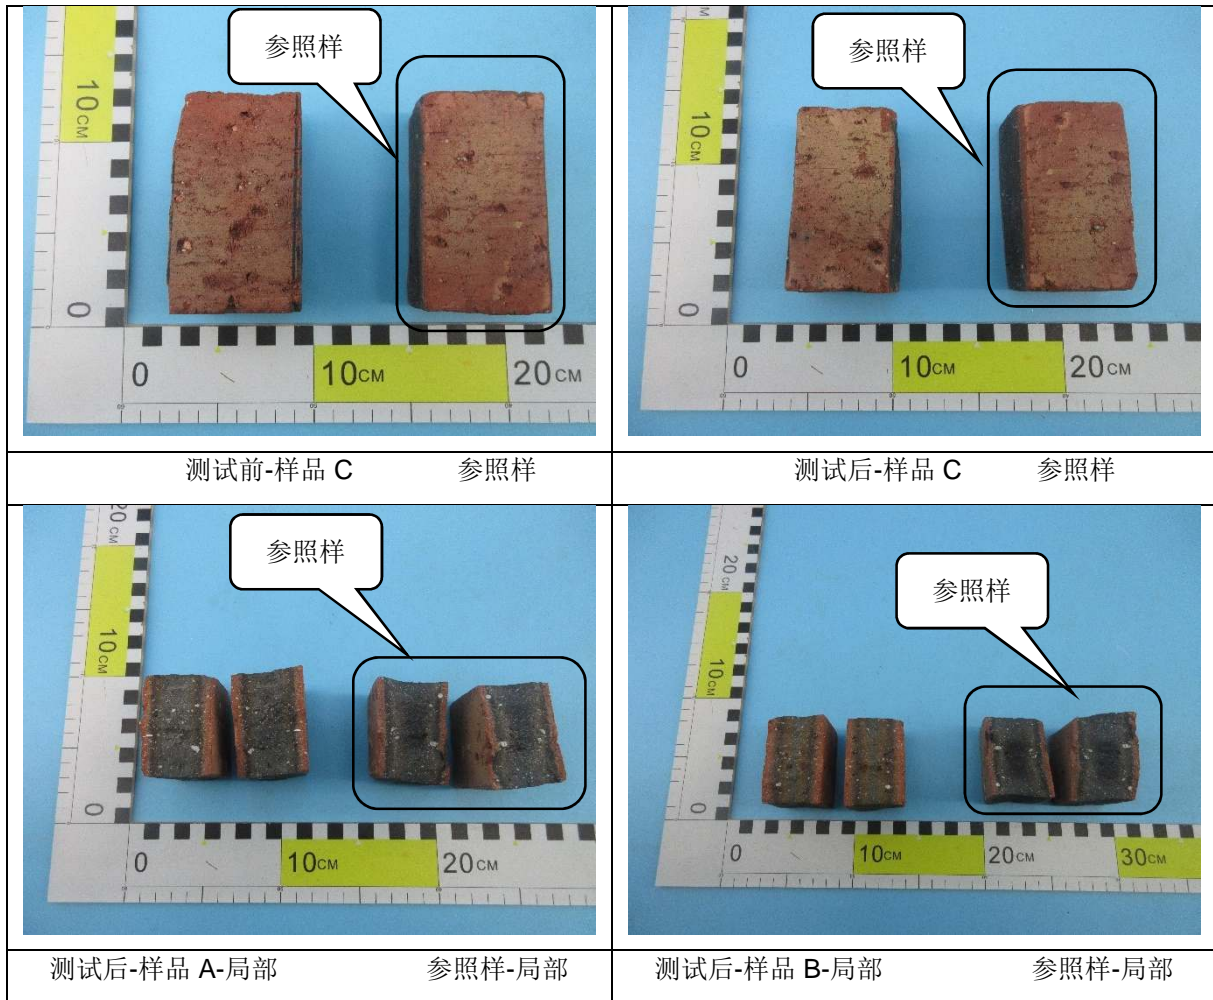


## 检测报告

编号 : GZIN2108046692MR\_CN

日期 : 2021-08-27

页码 : 6 of 6

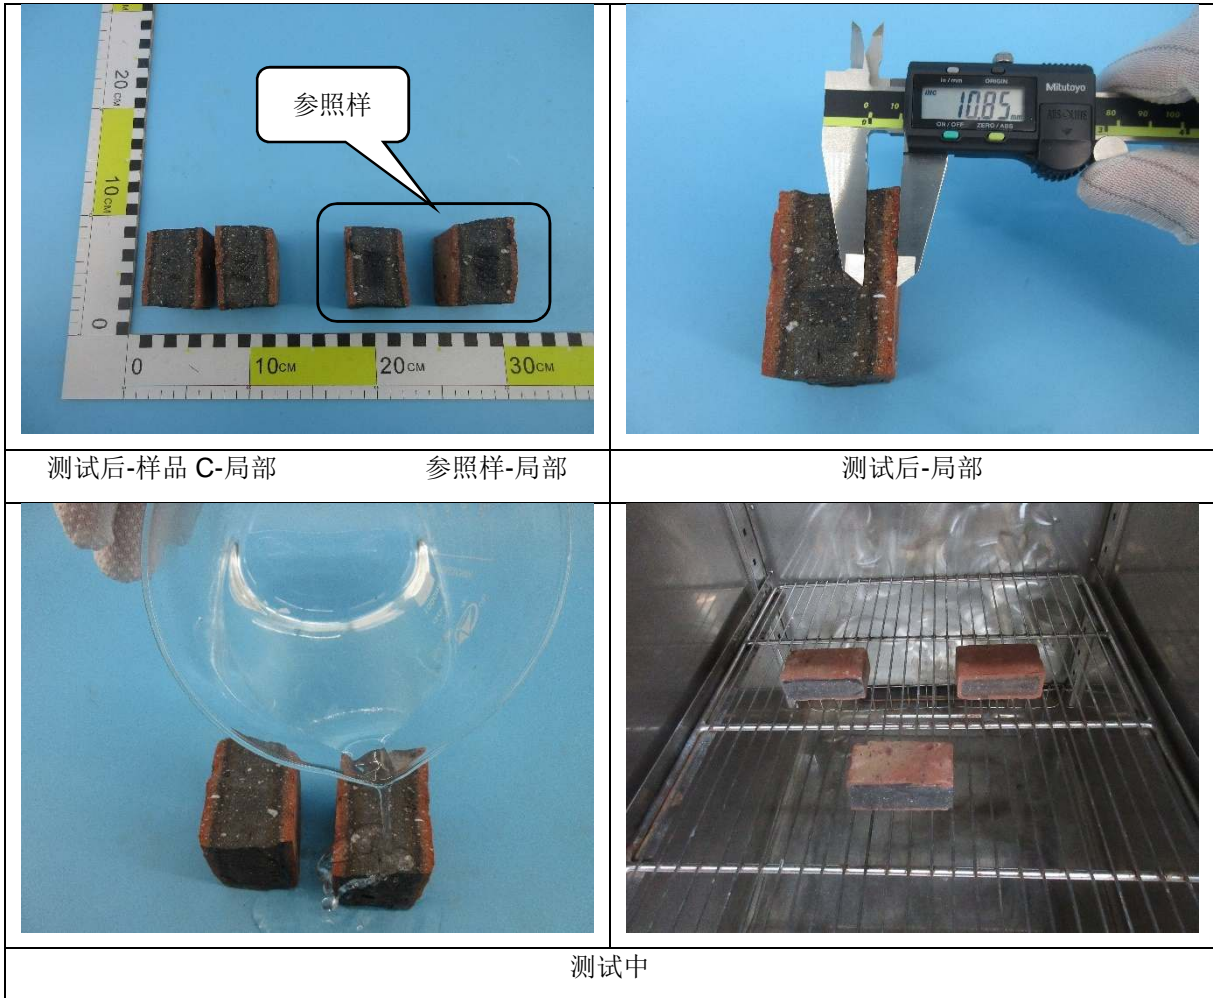

测试后-样品 C-局部

参照样-局部

测试后-局部

测试中

### 设备信息:

设备	型号	设备编号	校准日期	下次校准日期
高低温交变湿热试验箱	SETH-Z-042L	GZMR-AG-E088	2021-03-24	2022-03-23

\*\*\*\*\* 报告结束 \*\*\*\*\*



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only. Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

198 Kazhu Road, Sciencetech Park Guangzhou Economic & Technology Development District, Guangzhou, China 510663 t(86-20) 82155555 f(86-20) 82075188 www.sgs.com.cn

中国·广州·经济技术开发区科学城科珠路198号 邮编:510663 t(86-20) 82155555 f(86-20) 82075188 e sgs.china@sgs.com